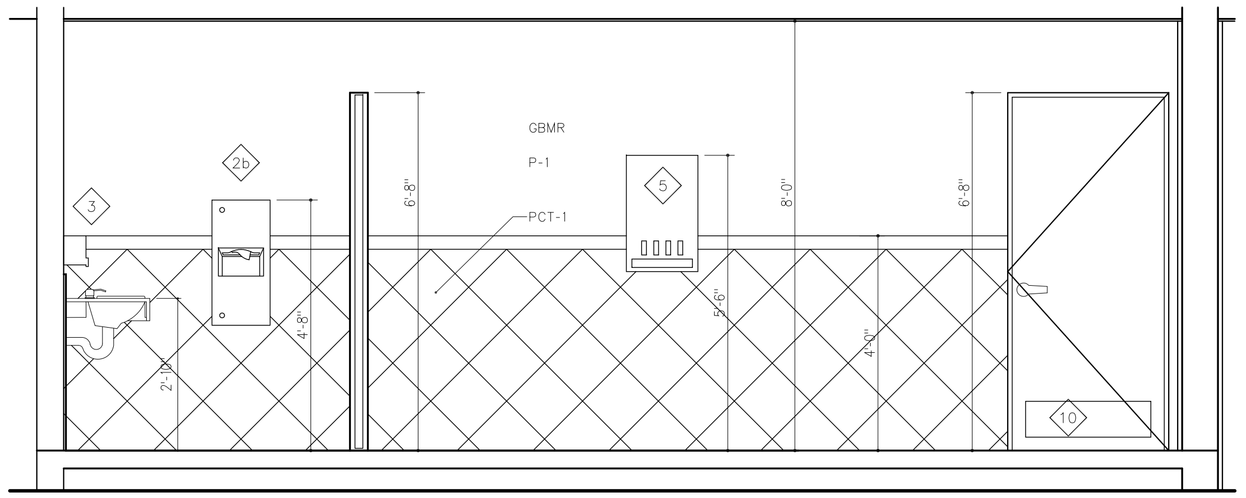

1

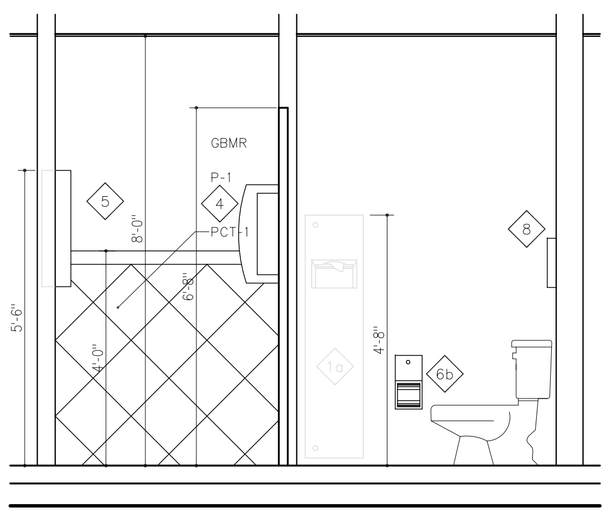

4

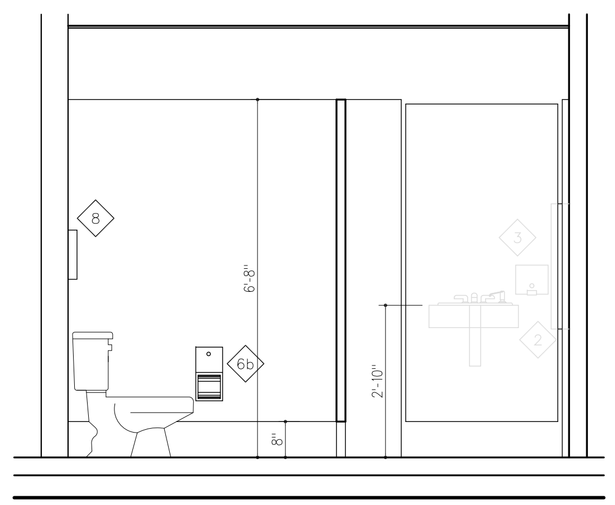

2

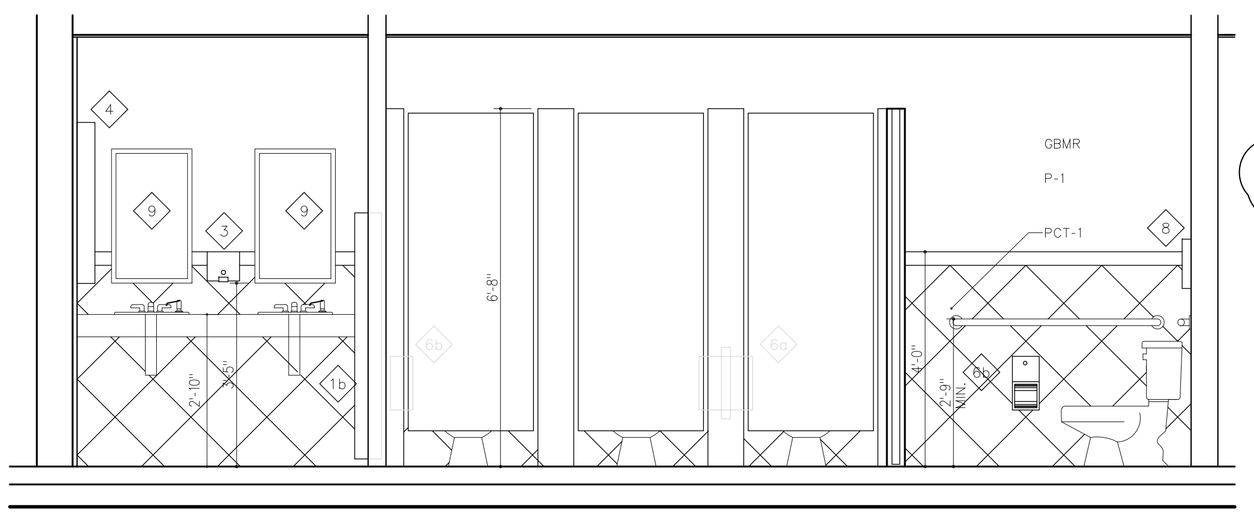

3

WOMEN BATHROOM ELEVATION BUILD. 2

2 1 0 1 2 3 4 SCALE: 1/2" = 1'-0"

LEGEND

- 1a — 7 GAL. PAPER TOWEL DISPENSER AND WASTE RECEPTACLE (SURFACE MOUNTED 64676-9)
- 1b — 7 GAL. PAPER TOWEL DISPENSER AND WASTE PECEPTACLE (4" RECESSED 64676-2)
- 2a — 1.8 GAL. PAPER TOWEL DISPENSER AND WASTE RECEPTACLE (SURFACE MOUNTED 64623-9)
- 2b — 1.8 GAL. PAPER TOWEL DISPENSER AND WASTE RECEPTACLE (4" RECESSED 64623)
- 3 — HORIZONTAL SOAP DISPENSER (9343)
- 4 — BABY CHANGING STATION (SURFACE MOUNTED 9012)
- 5 — SANITARY NAPKIN/TAMPON VENDOR (4"RECESSED 0468)
- 6a — DUAL ACCESS PARTITION MOUNTED DUAL TOILET PAPER DISPENSER (0032)
- 6b — SURFACE MOUNTED DUAL ROLL TOILET PAPER DISPENSER (0030)
- 7 — HEAVY DUTY UTILITY HOOK (1306)
- 8 — SURFACE MOUNTED TOLIET SEAT COVER DISPENSER (0477SM)
- 9 — MIRROR
- 10 — KICK PLATE

ALL TOILET ACCESSORIES BY AMERICAN SPECIALTIES INC. OR APPROVED EQUAL.

NOTES:

1. ACCESSIBLE WATER CLOSET DEPTH IS 30 INCHES AND IT IS FLOOR MOUNTED.
2. ACCESSIBILITY TO TOILET STALL DOOR IS IN COMPLIANCE WITH FACBC AND ADA GUIDLINES
3. TOILET ACCESSORIES TO BE APPROVED
4. IF PROVIDED, MIRROS SHALL BE MOUNTED WITH THE BOTTOM EDGE OF THE RELECTED SURFACE NO HIGHER NO HIGHER THAN 40 INCHES ABOVE THE FINISH FLOOR.
5. ALL PIPES UNDER LAVATORIES SHALL BE INSULATED OR OTHERWISE CONFIGURED TO PROTECT AGAINST CONTACT. THERE SHALL BE NO SHARP OR ABRASIVE SURFACE UNDER LAVATORIES.
6. ACCESSIBILTY TOILET STALL (COMPARTMENT) CAN BE 56" IN DEPTH IF YOU HAVE WALL MOUNTED WATER CLOSET. IF THE DEPTH OF A STANDARD A STANDARD ACCESSIBLE TOILET STALL IS INCREASED AT 3 INCHES, THEN A FLOOR MOUNTED WATER CLOSET MAY BE USED. FLOOR MOUNTED WATER CLOSET MAY BE USED. WE RECOMMEND A DEPTH OF 60" (1147.3)
7. THE CERAMIC TILES IN THE TOILET ROOM FLOORS SHALL BE NON-SLIP (NON-GLAZED) AND NON-ABSORBENT TILES, SLOPED TO FLOOR DRAIN. THE INTER-SECTION BETWEEN THE FLOOR AND WALL SHALL BE COVED. TILES ON WALLS SHALL BE INSTALLED TO A MIN. HEIGHT OF 4'-0" ABOVE THE FIN. FLOOR.
8. DIMENSIONS TO LOCATE PLUMBING FIXTURES ARE TO FINISHED SURFACE OF WALL

** THE CENTER OF SINK SHALL BE A MINIMUM OF 15 INCHES FROM THE SIDE WALL AS REQUIRED BY SECTION P405.3.1 OF THE FPC. FLOOR MOUNTED WATER CLOSET MAY BE USED.
** FOR VANITY MOUNTING HEIGHTS AND GRAB BAR DETAILS REFER TO A-11.1/15 , 17 & 18

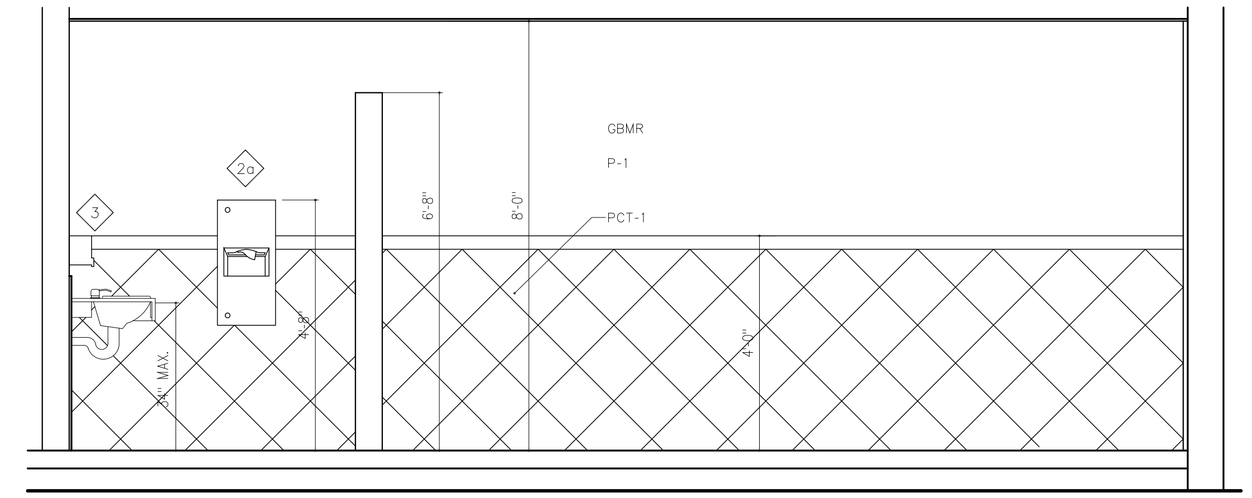

1

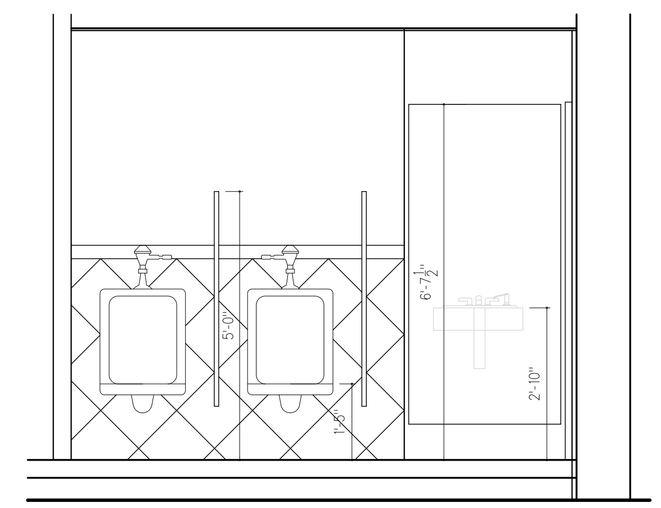

2

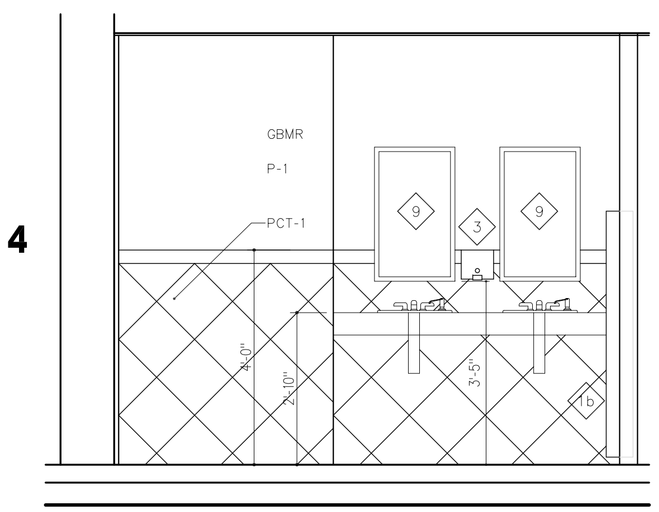

4

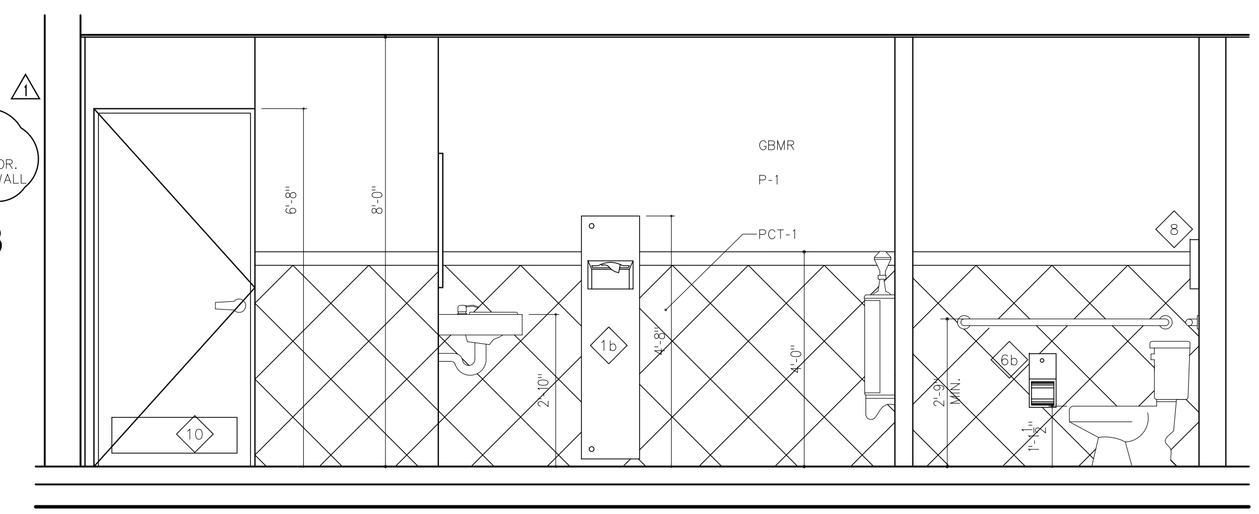

3

MEN BATHROOM ELEVATION BUILD.2

1 1 0 1 2 3 4 SCALE: 1/2" = 1'-0"

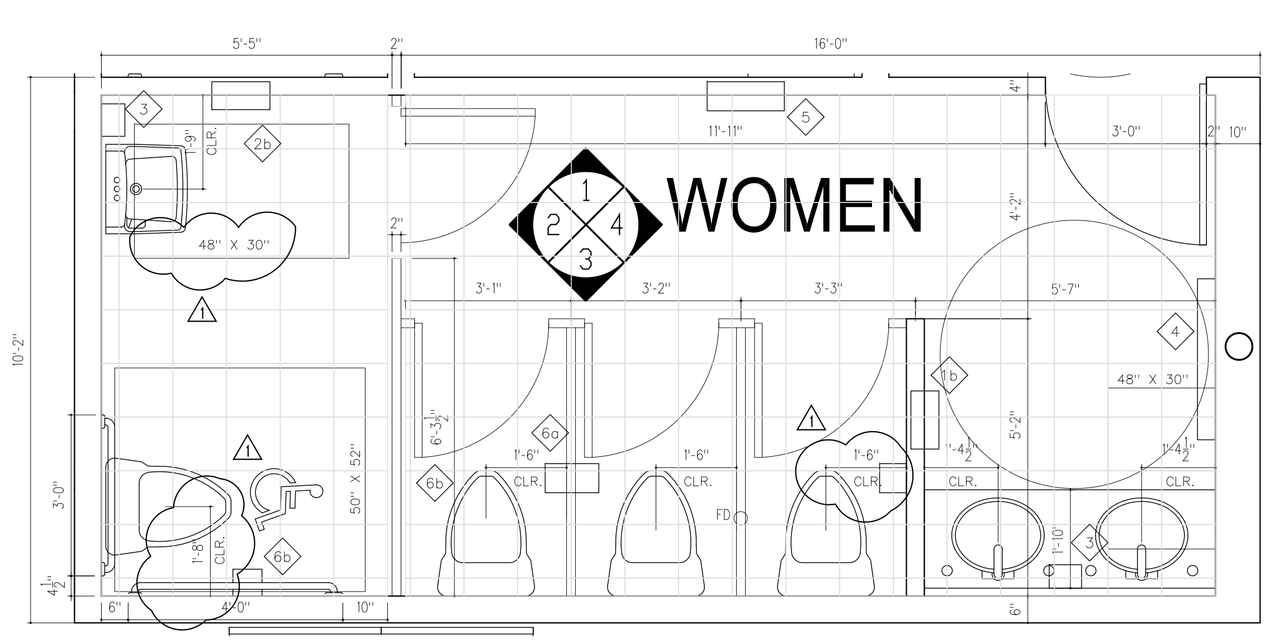

WOMEN RESTROOM BUILD. 2

1 0 1 2 3 4 SCALE: 1/2" = 1'-0"

MEN RESTROOM BUILD. 2

1 0 1 2 3 4 SCALE: 1/2" = 1'-0"

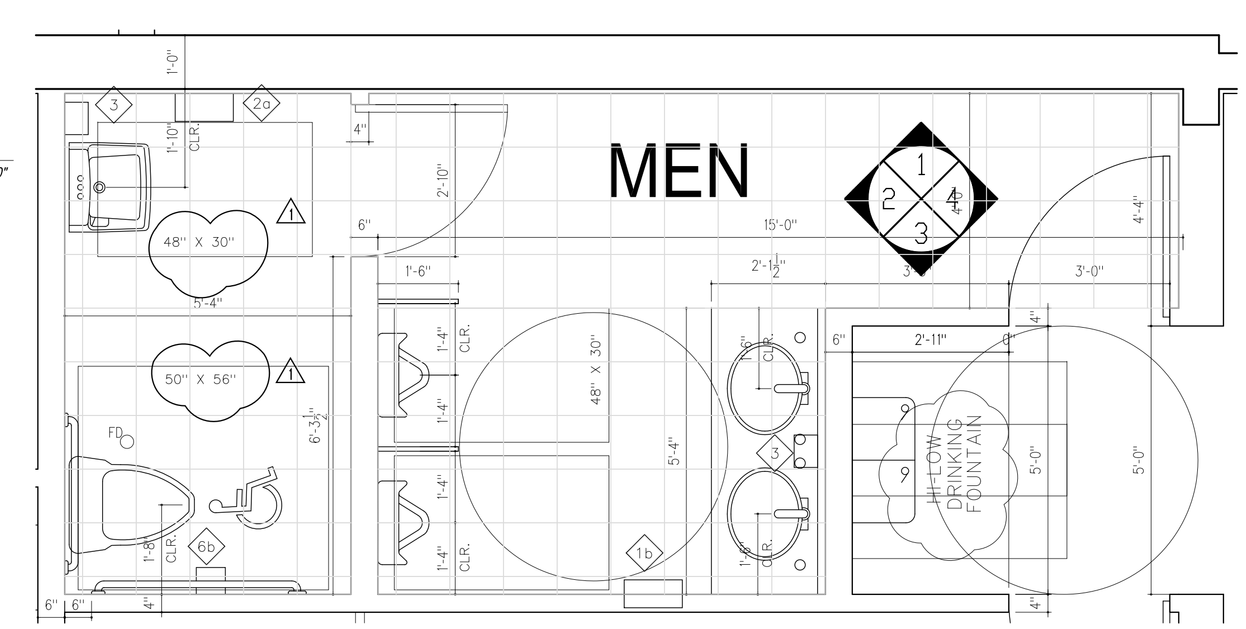

COPYRIGHT - 2008 - RAMOSMARTINEZ architects, inc.
All ideas, designs and details indicated or represented by this drawing, created and developed for use on this project are owned by, and are legal property of RamosMartinez Architects, Inc. Use, reproduction, distribution or alteration is prohibited without written authorization from the Architect.

RAMOSMARTINEZ
A R C H I T E C T S, I N C. AA 26000528
MIAMI
2121 N.W. 27th AVENUE
Miami, FL 33126
TELEPHONE: 305-548-3006
FACSIMILE: 305-548-3007
WEBSITE: www.rmarc.com
NEW YORK
1 JEFFERSON PLAZA
JERSEY CITY, NJ 07302
HUMBERTO RAMOS
AR 0017833

First Haitian Free Church of Nazarene by Faith
IN
ORLANDO, FLORIDA

FIRST HAITIAN FREE CHURCH OF NAZARENE

308 SOUTH ORANGE BLOSSOM TRAIL
ORLANDO, FLORIDA

RESTROOM FLOOR PLANS

ENLARGED PLANS

REVISIONS:
1 Building Department Comments 03/26/09

COMM. NO. 08-103
DATE:
DRAWN BY:
CHECKED BY:

A-9.5